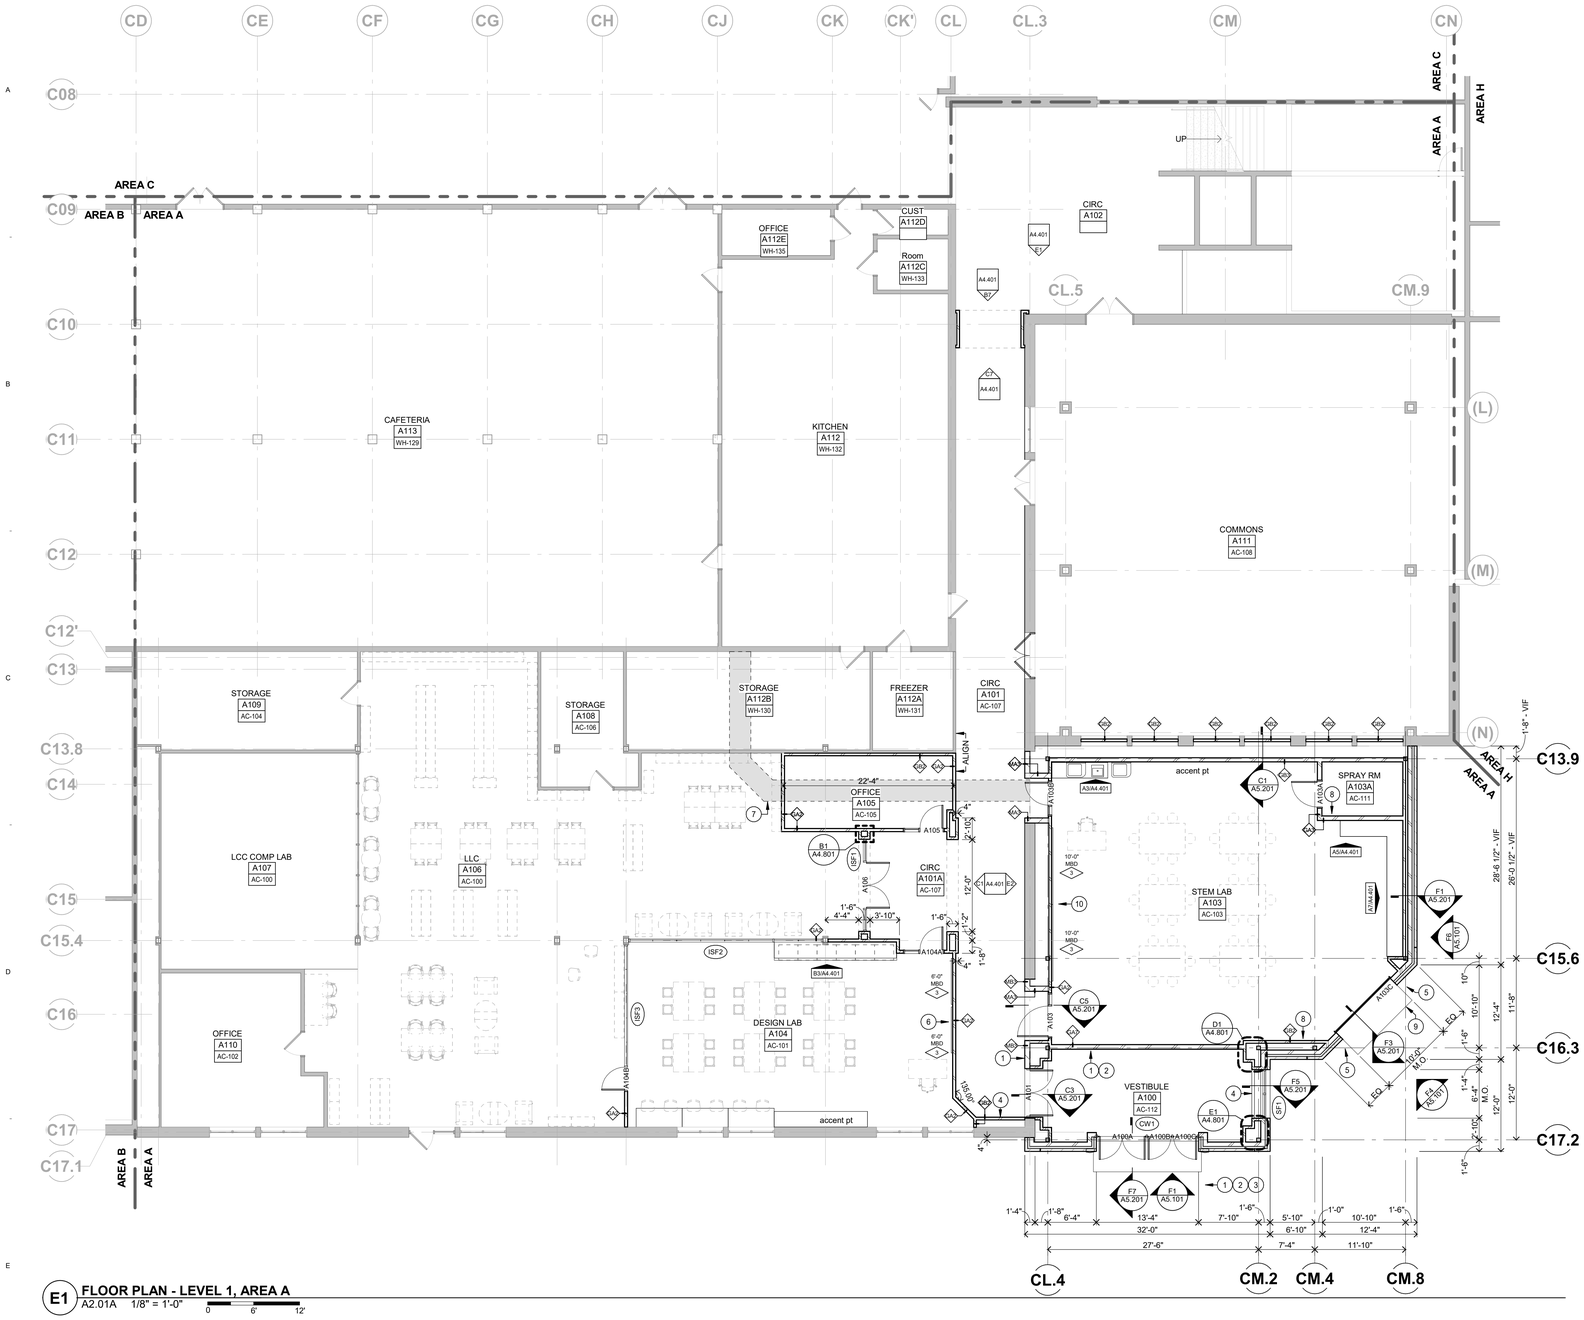

E1 **FLOOR PLAN - LEVEL 1, AREA A**
A2.01A 1/8" = 1'-0" 0 6' 12'

PLAN GENERAL NOTES

1. ALL PLAN DIMENSIONS ARE NOMINAL TO FACE OF WALL. WALL THICKNESSES ARE SHOWN NOMINAL, SEE WALL TYPES FOR ACTUAL THICKNESS.
2. ALL GYP. WALLS ARE TO BE 5 INCHES THICK UNLESS OTHERWISE NOTED.
3. ALL CONCRETE BLOCK WALLS ARE TO BE 8 INCHES THICK UNLESS OTHERWISE NOTED.
4. COORDINATE SIZE AND LOCATION OF ALL DUCT AND SHAFT OPENINGS IN WALLS AND FLOORS W/ MECH. AND ELEC. PROVIDE ALL REQUIRED LINTELS FOR OPENINGS. SEE LINTEL SCHEDULE.
5. FIELD VERIFY ALL CASEWORK & MILLWORK OPENINGS.
6. SET FLOOR DRAINS 3/4" BELOW FINISHED CONCRETE FLOORS UNLESS OTHERWISE NOTED. PROVIDE CONSISTENT SLOPE FROM WALL TO DRAIN BY SLOPING CONCRETE, MIN. 1/4" PER FOOT.
7. VERIFY LOCATION, SIZE AND QUANTITY OF ALL MECHANICAL AND ELECTRICAL EQUIPMENT PADS.
8. ALL DOOR/SIDELITE OPENINGS TO BEGIN 4" FROM ADJACENT WALL UNLESS OTHERWISE NOTED.
9. ALL GYP. WALLS ARE CENTERED ON GRID UNLESS OTHERWISE NOTED.
10. FIRE RATED WALLS ARE INDICATED ON LIFE SAFETY PLANS.

FLOOR PLAN KEY NOTES:

1. HCAP ACTUATOR BUTTON - COORDINATE WITH ELECTRICAL
2. CARD READER - COORDINATE WITH ELECTRICAL
3. ACTUATOR BOLLARD FOR HCAP ACTUATOR BUTTON AND CARD READER - COORDINATE WITH ELECTRICAL
4. CABINET UNIT HEATER (CUH)
5. BOLLARD
6. WALL MOUNTED MONITOR (NIC) - COORDINATE WITH ELECTRICAL. SEE ALSO DETAIL D3/A4.701.
7. PATCH CONCRETE SLAB AT AREAS OF REMOVAL - SEE ALSO DETAIL
8. PORTABLE FIRE EXTINGUISHER - SEE ALSO LIFE SAFTY PLANS.
9. CONCRETE APRON - SEE STRUCTURAL.
10. RETRACTABLE OVERHEAD PROJECTOR SCREEN

ROOM FINISH SCHEDULE

ROOM NO	ROOM NAME	FLOOR	BASE	N WALL - TYP		E WALL		S WALL		W WALL		REMARKS
				MATL	FIN	MATL	FIN	MATL	FIN	MATL	FIN	
A100	VESTIBULE	CPT-1	TILE	GYP BD	PT-6A/TILE	GYP BD		GYP BD		GYP BD		
A101	CIRC	LVT-1 / LVT-2	TILE	-	-	EXIST /				EXIST /		
A101A	CIRC	LVT-1 / LVT-2	TILE	GYP BD		GYP BD		GYP BD		GYP BD		
A102	CIRC	EXIST		EXIST	EXIST	EXIST	EXIST					
A103	STEM LAB	CONC-1	VB	GYP BD	PT-6A	GYP BD	PT-6A	GYP BD	PT-6A	GYP BD	PT-	
A103A	SPRAY RM	CONC-1		GYP BD	PT-	GYP BD	PT-	GYP BD	PT-	GYP BD	PT-	
A104	DESIGN LAB	LVT-1	VB	GYP BD	PT-6A	GYP BD	PT-6A	EXIST	PT-6A			
A105	OFFICE	CPT-2	VB	EXIST	PT-6A	GYP BD	PT-6A	GYP BD	PT-6A	GYP BD	PT-6A	
A106	LLC	CPT-2	VB									
A107	LCC COMP LAB	CPT-2	VB	EXIST	EXIST	EXIST	EXIST	EXIST	EXIST	EXIST	EXIST	
A108	STORAGE											
A109	STORAGE											
A110	OFFICE	CPT-2	VB	EXIST		EXIST		EXIST		EXIST		
A112B	STORAGE											

DOOR / OPENING SCHEDULE

DOOR NO	DOOR / OPENING					OVERALL WIDTH	LABEL/ RATING	FRAME				MOUNTING CONDITIONS			HDW GRP	REMARKS
	TYPE	QTY	WIDTH	HEIGHT	MATL			TYPE	DEPTH	MATL	GL	HEAD	JAMB	SILL		
A100A	FG	2	3'-0"	7'-0"	AL		--	CW X	--	AL	--	SEE ELEVATION	SEE ELEVATION	SEE ELEVATION		
A100B	FG	1	3'-0"	7'-0"	AL		--	CW X	--	AL	--	SEE ELEVATION	SEE ELEVATION	SEE ELEVATION		
A100C	FG	1	3'-0"	7'-0"	AL		--	CW X	--	AL	--	SEE ELEVATION	SEE ELEVATION	SEE ELEVATION		
A101	FG	2	3'-0"	7'-0"	AL		--	SF X	--	AL	--					
A103	F	1	4'-0"	7'-0"	WD		--	FR 3A	--	HM	--					
A103A	F	1	3'-4"	7'-0"	WD	3'-8"	45 MIN	FR 1A	--	HM	--					
A103B	F	1	3'-0"	7'-0"	WD		--	FR 3A	--	HM	--					
A103C								OH								
A104A	F	1	3'-0"	7'-0"	WD		--	FR 3A	--	HM	--					
A104B	FG	1	3'-0"	7'-0"	AL		--	SF X	--	AL	--					
A105	F	1	3'-0"	7'-0"	WD		--	FR 3A	--	HM	--					
A106	FG	2	3'-0"	7'-0"	AL		--	SF X	--	AL	--					
A106G	F	2	2'-10"	7'-0"	WD		--	EXIST	--	HM	--					

DOOR / OPENING SCHEDULE GENERAL NOTES

1. ALL DOORS ARE 1 3/4" THICK UNLESS OTHERWISE NOTED.
2. FOR FRAME DEPTH, ONLY EXCEPTIONS TO THE FOLLOWING TABLE ARE SCHEDULED:

   GYPSUM BOARD PARTITIONS: THROAT OF FRAME TO MATCH WALL THICKNESS.

   MASONRY PARTITIONS:

   4" WALL: 3 3/4" FRAME
   6" WALL: 5 3/4" FRAME
   8" AND GREATER WALL: 7 3/4" FRAME

   FRAME DEPTHS ARE SCHEDULED IN NOMINAL DIMENSIONS. SEE FRAME/ DOOR TYPES (DETAIL SECTION 51000) FOR CORRESPONDING ACTUAL DIMENSIONS.
3. FOR GLASS TYPES, ONLY EXCEPTIONS TO THE FOLLOWING TABLE ARE SCHEDULED:

   INTERIOR NON RATED:

   CLEAR (SAFETY WHEN REQUIRED BY TABLE IN GLAZING SPECIFICATION.)

   INTERIOR AND EXTERIOR RATED:

   FIRE RATED

   EXTERIOR NON-RATED:

   CLEAR INSULATED (SAFETY INSULATED WHEN REQUIRED BY TABLE IN GLAZING SPECIFICATION.)
4. SEE SHEET AX.XX FOR FRAME TYPES.
5. SEE SHEET AX.XX FOR DOOR TYPES.
6. AT DOOR SCHEDULE, LABEL DESIGNATION "45/20" INDICATES:

   FOR ALL OPENINGS WITH SIDE LITES AND SCHEDULED TO BE RATED FOR 20 MINUTES, THE DOOR AND ANY GLASS WITHIN THE DOOR IS TO BE RATED FOR 20 MINUTES; THE FRAME AND ADJACENT SIDELITE(S) GLASS AND FRAME IS TO BE RATED FOR 45 MINUTES."

DOOR / OPENING SCHEDULE REMARKS

1. SEE DETAIL 43018 FOR USE WITH ALTERNATE #1
2. SEE DETAIL 54012 FOR USE WITH ALTERNATE #1
3. PROVIDE FIRE NUMBER AT EXTERIOR DOORS DOOR NUMBER IN A "_"

SITE PLAN REVIEW DRAWINGS
NOT FOR CONSTRUCTION

CRETIN-DERHAM HALL STEM ADDITION

550 South Albert Street
Saint Paul, MN 55116

CRETIN-DERHAM HALL

550 South Albert Street
Saint Paul, MN 55116

WOLD ARCHITECTS AND ENGINEERS
332 Minnesota Street, Suite W2000
Saint Paul, MN 55101

woldac.com | 651 227 7773



KEY PLAN

I hereby certify that this plan, specification or report was prepared by me or under my direct supervision and that I am a duly Licensed **ARCHITECT** under the laws of the State of **MINNESOTA**

Vaughn Dierks
License Number: **26579** Date: **2021.03.12**

Revisions		
Description	Date	Num

Comm: **212017**
Date: **2021.03.12**
Drawn: **KLS**
Check: **Checker**
North

FLOOR PLAN - LEVEL 1, AREA A

Scale: **As Indicated**

A2.01A

MN

A

C:\Users\klsmith\Documents\21017_4_KSM-Wolfac.rvt admin@wolfac.com
Central - /Projects/21xxx/21017/Revit/Prj/Cretin Derham Hall 4/2020 - 21017 - STEM Addition.rvt
3/1/2021 3:57:29 PM